

FIG. 1

ANTISERA OF RATS IMMUNIZED WITH KLH-COMPOUND 1

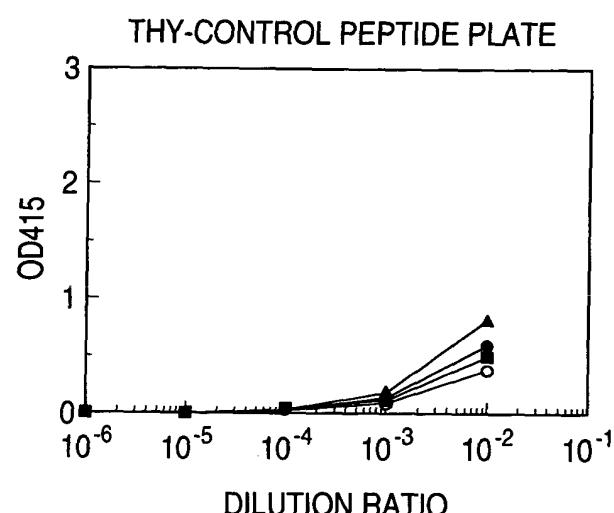
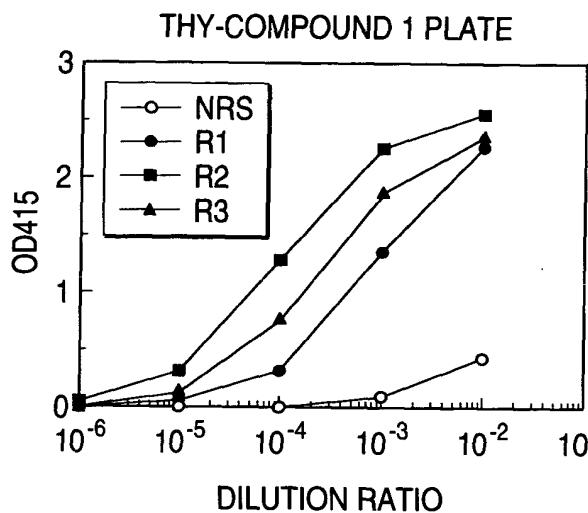


FIG. 2

ANTISERA OF RATS IMMUNIZED WITH KLH-COMPOUND 2

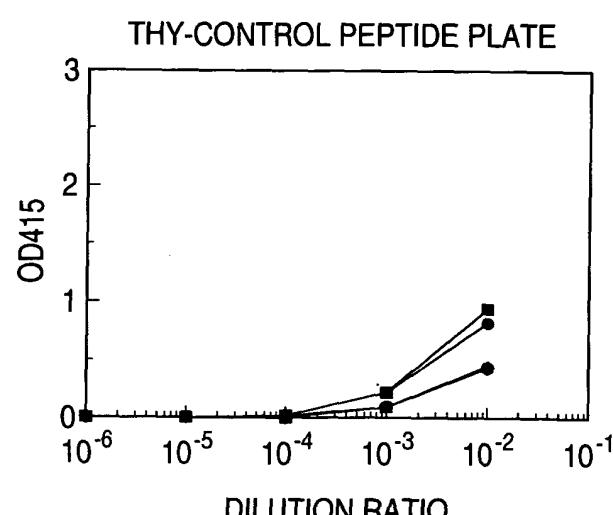
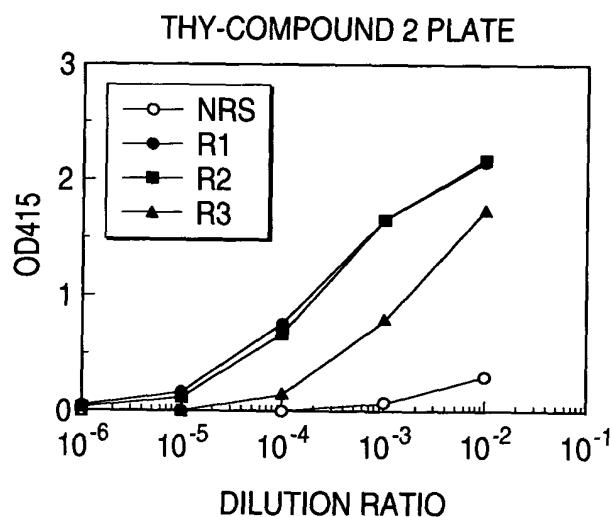


FIG. 3

ANTISERA OF RATS IMMUNIZED WITH KLH-COMPOUND 3

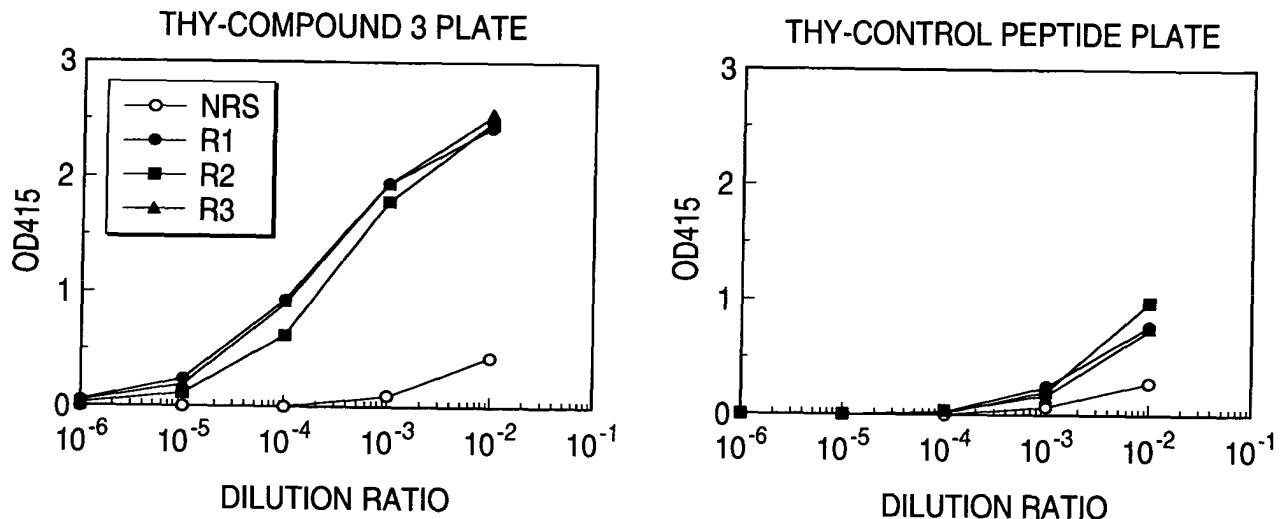


FIG. 4

ANTISERA OF RATS IMMUNIZED WITH KLH-COMPOUND 4


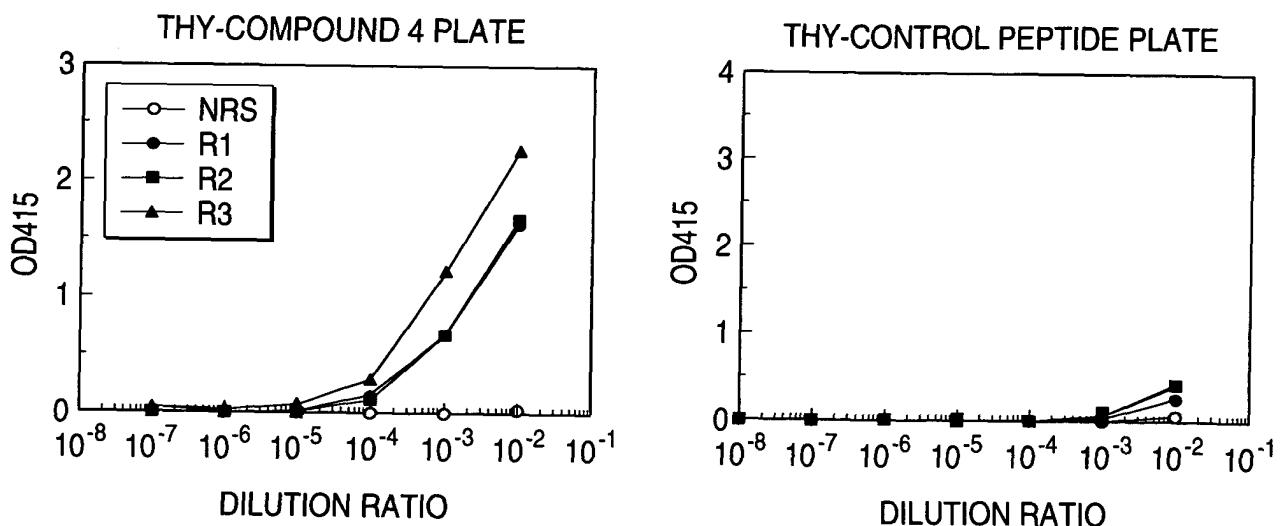


FIG. 5

ANTISERA OF RATS IMMUNIZED WITH KLH-COMPOUND 5

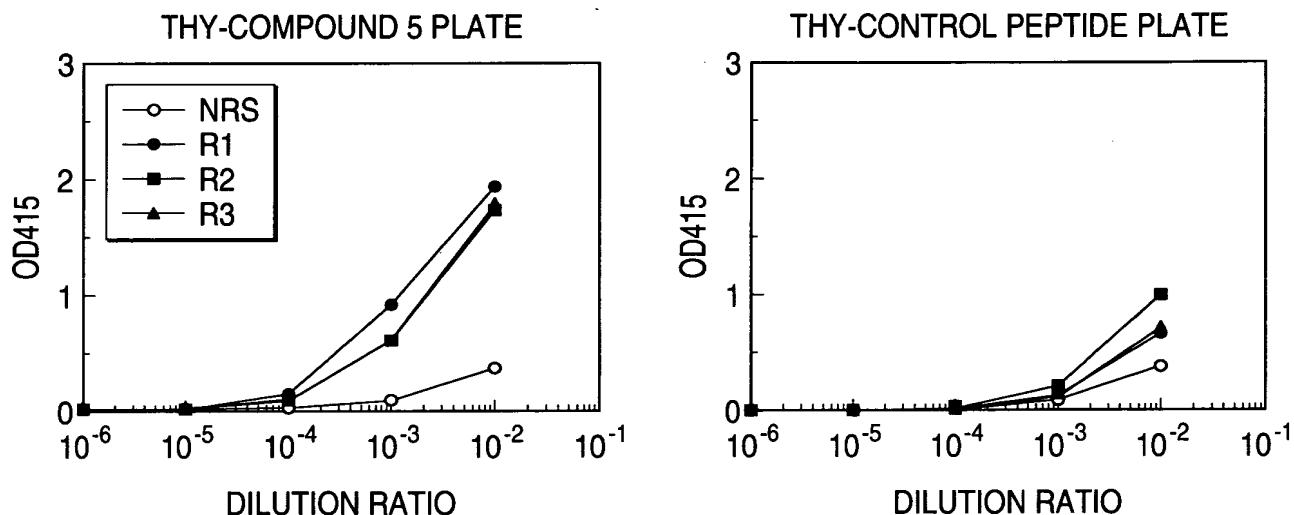

THERMOTEST® 250°C 600

FIG. 6

ANTISERA OF RATS IMMUNIZED WITH KLH-COMPOUND 6

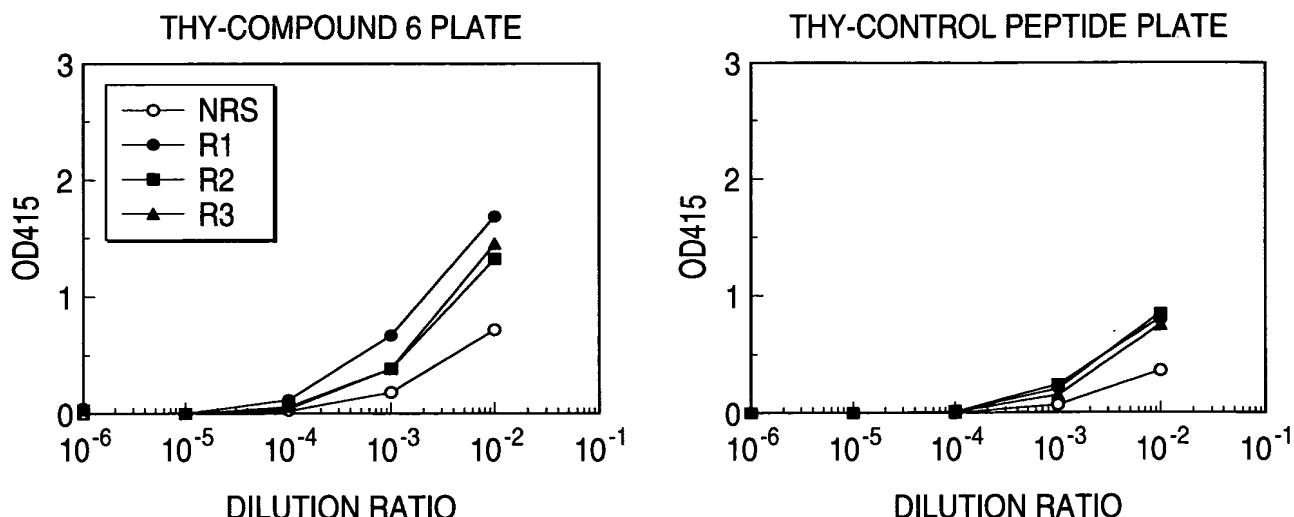


FIG. 7

ANTISERA OF RATS IMMUNIZED WITH KLH-COMPOUND 7

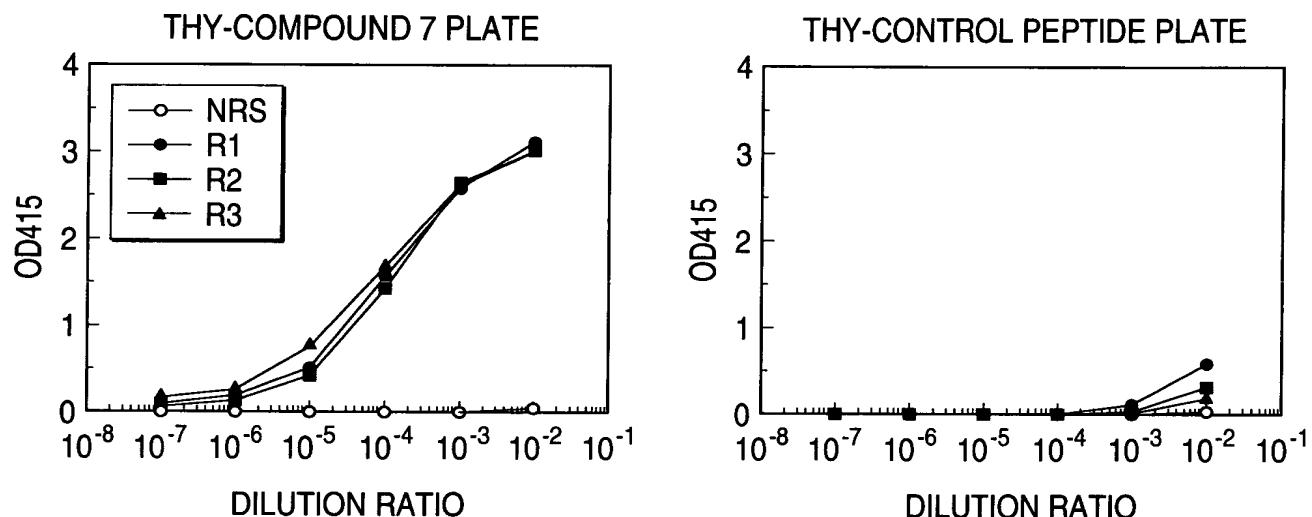


FIG. 8

ANTISERA OF RATS IMMUNIZED WITH KLH-COMPOUND 8

